

DIAGRAMA QDFL-ESCOLA

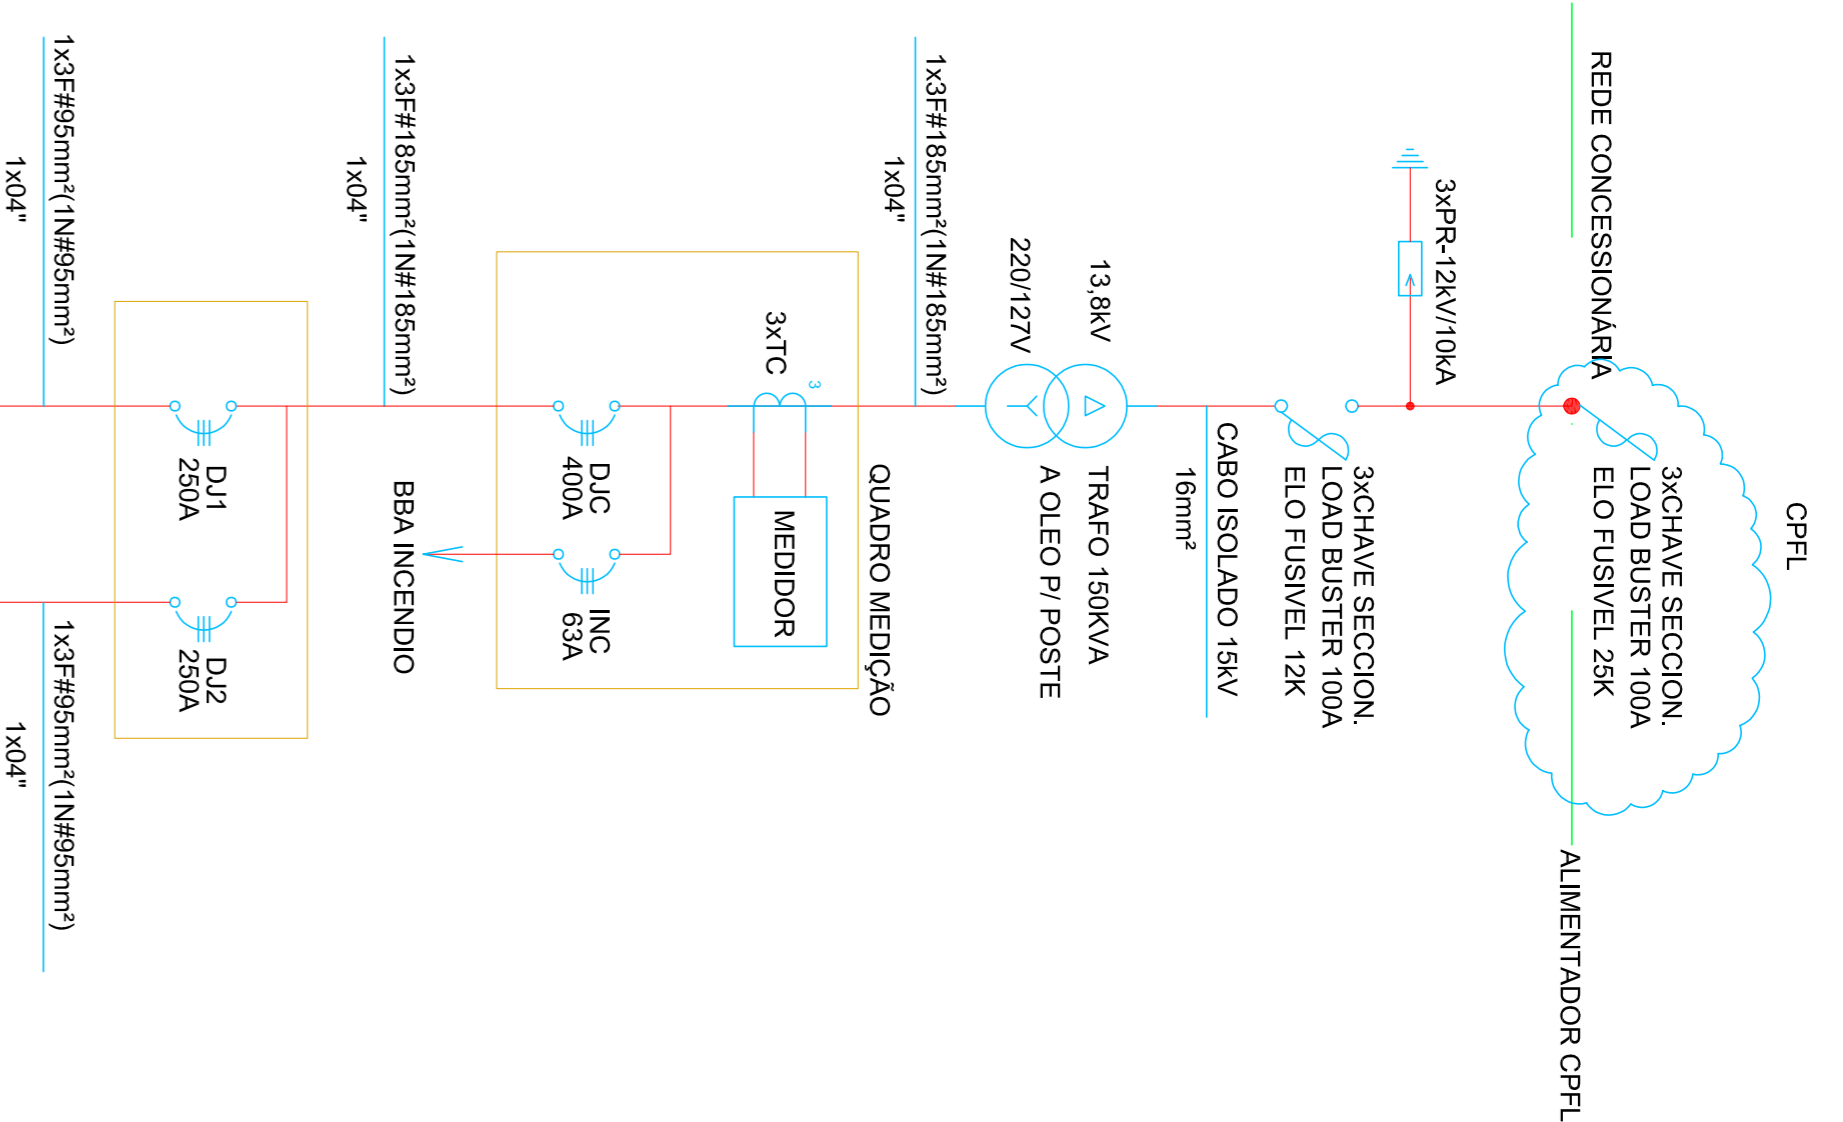


DIAGRAMA QD-AR ESCOLA

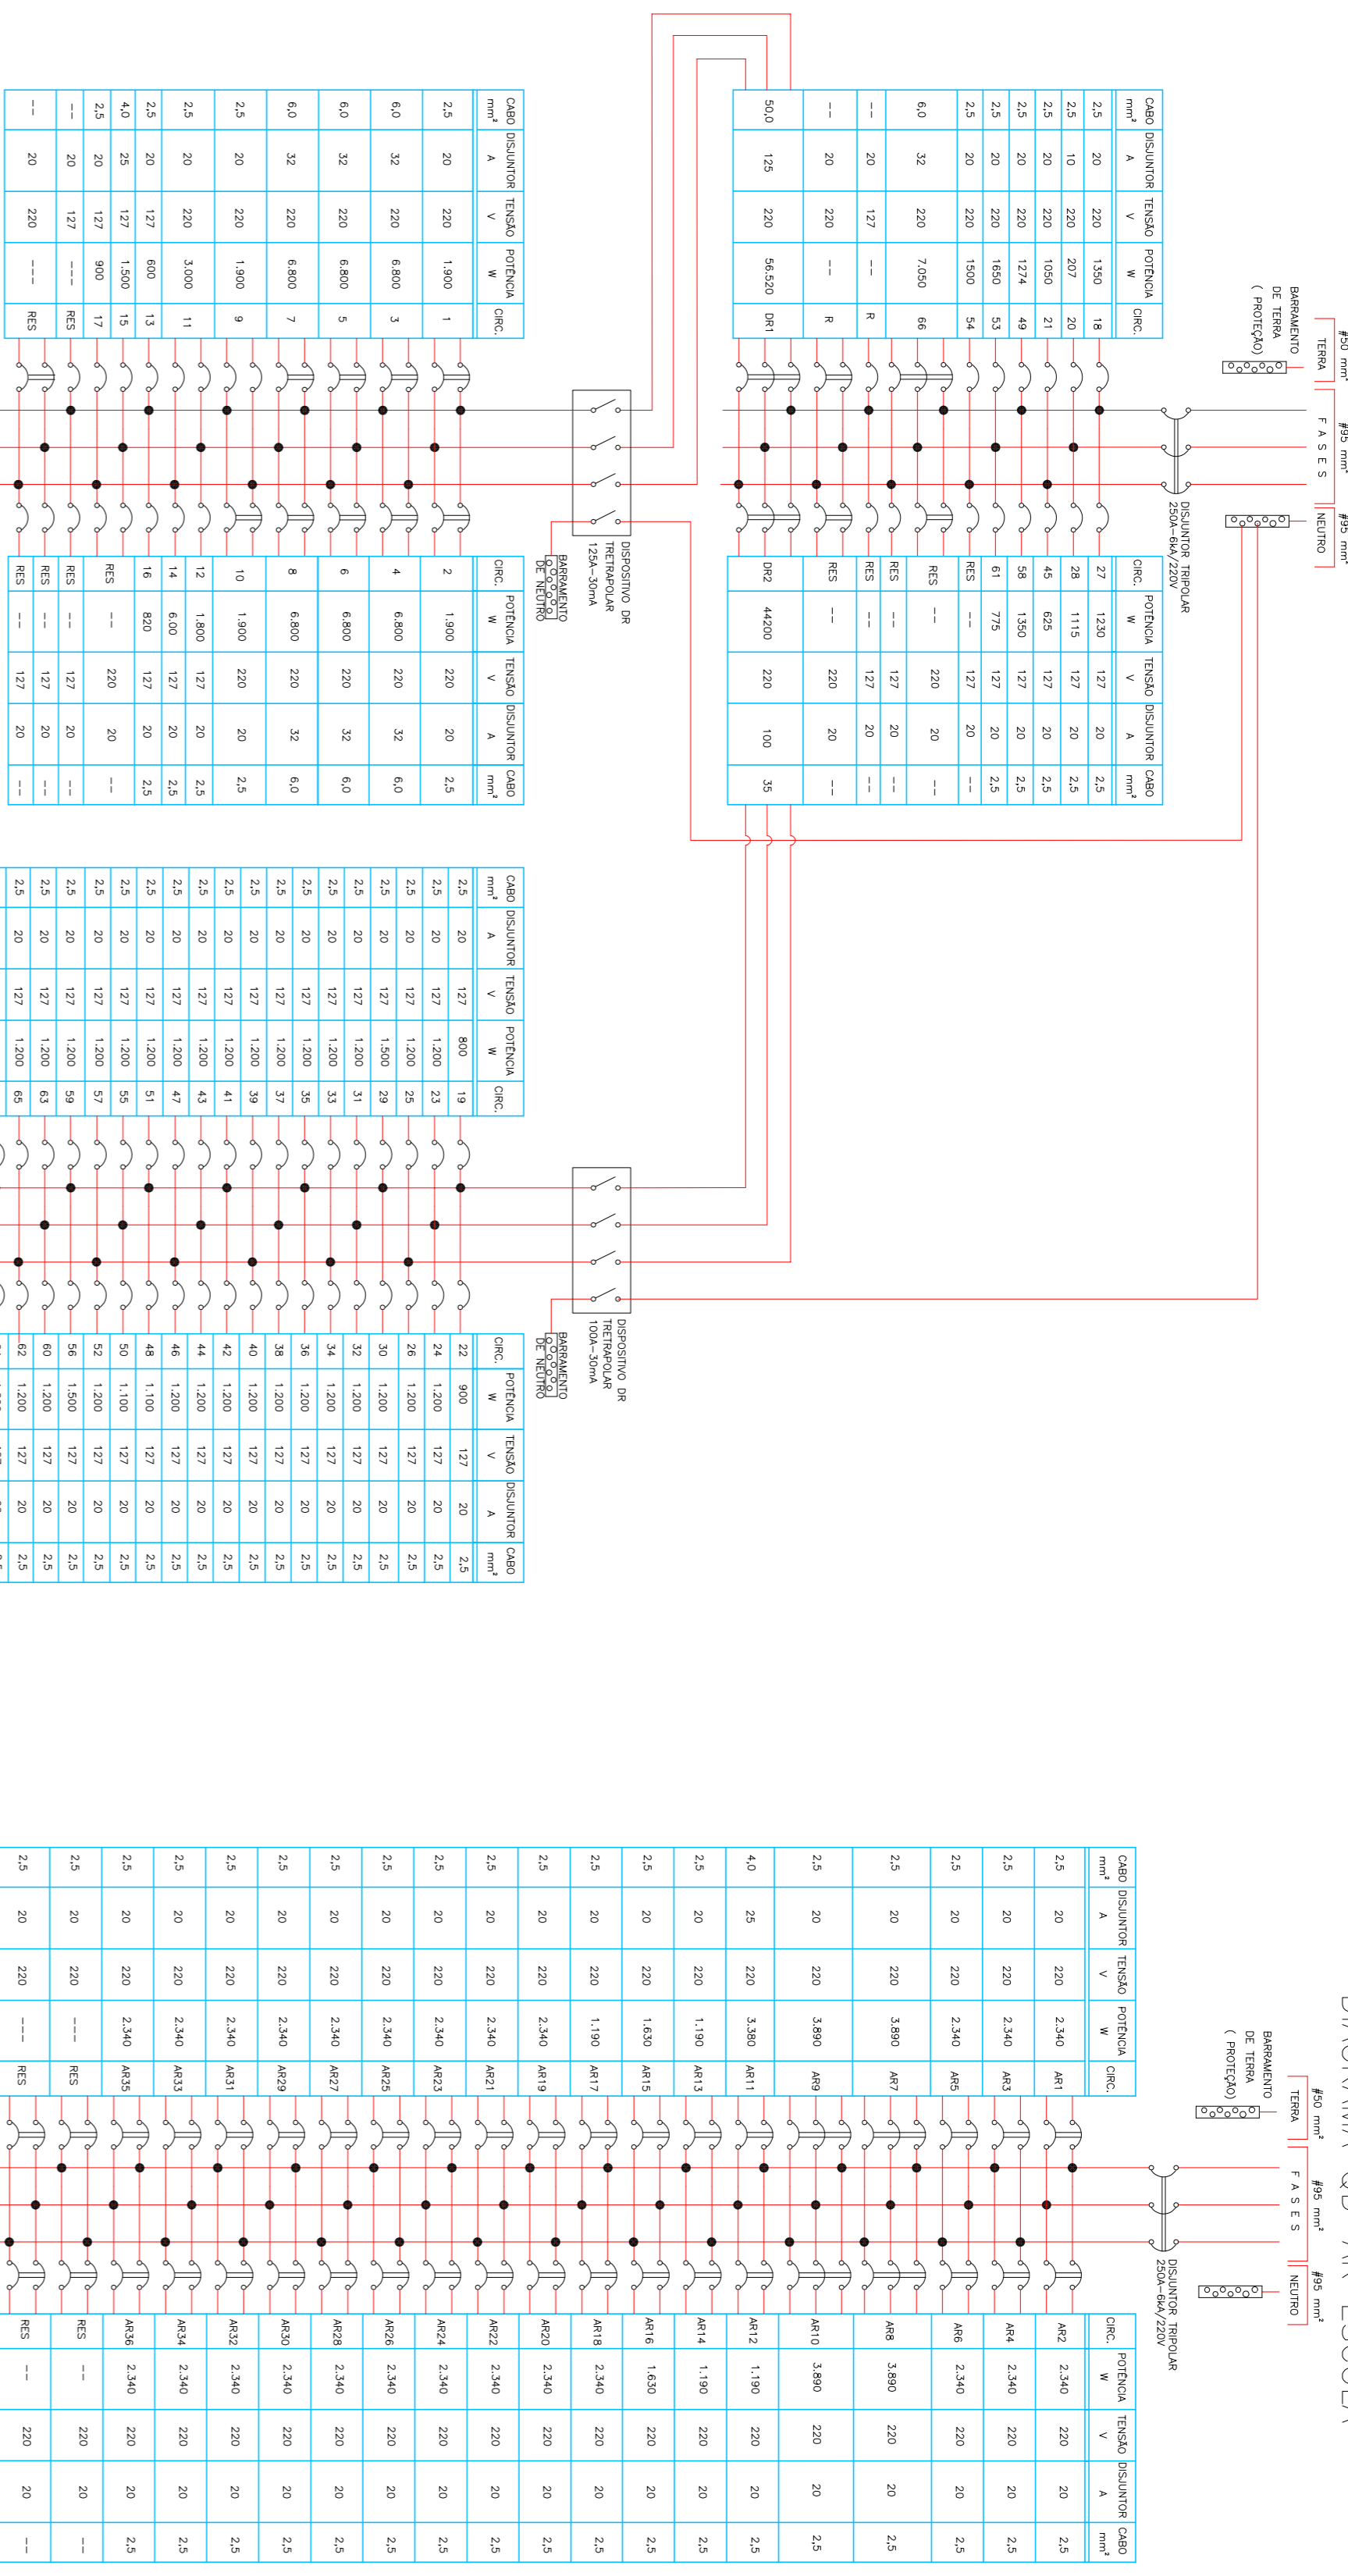


DIAGRAMA UNIFILAR GERAL

Table with 4 columns: QUANT, CIRCUITO, POTÊNCIA UNITÁRIA (W), POTÊNCIA TOTAL (W), FATOR DEMANDA GED 2856, POTÊNCIA TOTAL (VA). Lists various circuits like CHUVEIRO, AR CONDICIONADO, and ILUMINAÇÃO.

Table with 4 columns: Unidade de Consumo, Demanda Calculada, Categoria de Atendimento, Cabo, Disjuntor Tripolar, Identificação. Shows demand calculation for 125.412 units.

Entrada Trifásica - Posição de Transformação com Tensão 150kVA - 13,8kV / 220-127V. Cabo de Cobre Isolado 750 V # 185mm² (para as fases) # 185 mm² (neutro-co-azul-dara).

QDFL-ESCOLA

Summary table for QDFL-ESCOLA listing circuit numbers, names, power ratings, and protection details for various rooms.

QD-AR

Table for QD-AR listing circuit numbers, names, power ratings, and protection details for specific equipment like air conditioning and lighting.

ELETRICA

DIAGRAMAS UNIFILAR / TRIFILAR / TABELA CARGAS. ELE 05/05. Includes logos for BSBY, BASSITT, and CRS Engenharia.

Project information form with fields for client (PREFEITURA MUNICIPAL DE BABY BASSITT - SP), location (ENTRE RUA 02 E RUA 03, LOTEAMENTO JD. TANGARA), and contact details.